

A New Algorithm Based on Dynamic Programming for Generation Expansion Planning (Case Study: Khuzestan Power Grid in Iran)

Bahram Noshad¹

1- Department of Electrical Engineering, Mahshahr Branch, Islamic Azad University, Mahshahr, Iran

E-mail: bahramnoshad@yahoo.com

Abstract- In generating expansion planning, the Loss of Load Probability index is one of the most vigorous indices for reliability system. Generating expansion planning is one of the most significant parts in grid expansion planning. The generating expansion planning extends from 10 to 30 years and reliability is one of the most important constraints in power stations. This paper tends to represent primarily generating expansion evaluation with the help proposed algorithm based on dynamic programming using the MATLAB program for Khuzestan power grid in Iran within a time period of 10 years (2014- 2024).

Keywords: Generating Expansion Planning, Loss of Load Probability, MATLAB program.

I. Introduction

The purpose of Generation expansion planning is to find a combination of power plants to obtain consumers needed load effectively and oppose the minimum cost on system for load supply. To accomplish this goal, some considerations should be taken in to account, such as the type of power plant, its capacity, and its time and location settlement. This type of planning is usually carried out for duration between 10 to 30 years [1]. Generation expansion planning is one of the most important parts in grid expansion planning. If the consumers load distribution for intended geographical area or the fuel supply cost is uniform, it will be expected to have the maximum optimization with the help of wasp program. Unfortunately, these assumptions are not always accurate. If modern power plants are located in centers much further away from loads, it will be expected to oppose so much cost to set transmission lines. On the other hand, if these power plants are centralized very closely to load and further from fuel supply, it may lead to enhance fuel cost [1-2]. The barrier that hinders from representing a comprehensive solution for optimization problem is the vast dimensions of the problem caused by a large number of decision-making variables, the existence of constraints, and non linear behavior; however, the proposed methods benefit of simplification for reducing its diminutions [1]. WASP program is one of the most powerful instruments for generation expansion planning. The implied assumption in this program is that the total amount of load and all power

plants generation are centralized in one bus. This presupposition has brought the reduction of problem dimensions and makes the problem easy to solve [1]. So generation expansion planning will not obtain optimal response, otherwise, it regards several considerations including load geographical distribution, constraints on fuel supply, electrical power transmission by transmission lines, and other constraints resulted from geographical limitations, land cost and go forth. It also should be noted that covering electrical load changes (both time and place) without having auxiliary storage with high capacity seems to be impossible. In similar vein, having intermittent system with long distance is impossible some load changes occur mildly along 24 hours called middle load produced by average load power plants such as hydro-power plants and gas-power plants (power-plants with constant average generation and low variable cost). Some other loads called peak load characterizes with high change that occurs four hours in day. To cover these loads the above mentioned power plants cannot be applied. Among the abundant proposed and used solutions are spinning reserve, using big system with various horizons (extended in geographical altitude), using diesel generators, small. Hydro-power plants, small gas-power plants, steam power plants with high speed in generation level change, pumped-storage power plants, and so on. Among the electrical storage systems we can refer to super conductive storage system, batteries, dense-air storage system, dense-air storage system inherent in pipes, and pumped-storage power plans [3-8]. One of the most prominent constraints in generating expansion planning is validity constraint that is introduced by loss of load probability (LOLP). The present study tends primarily to offer generation expansion evaluation for Khuzestan power grid in Iran within a time period of 10 years (2014-2024) based on dynamic programming using the MATLAB program.

II. Proposed Algorithm

In the proposed algorithm, the objective function pertains to minimizing the sum of maintenance cost, fuel, outage, and ... in power plants and constraints are characterized by the balance between generation and load, reliability and so on.

A. Objective Function

Objective function in this algorithm is minimizing of below relation:

$$\text{Objective function} = \sum_{t=1}^T \sum_j (I_{jt} + F_{jt} + M_{jt} + O_{jt} - S_{jt}) \quad (1)$$

In above formulation j , and T represent type of power plants and time period related to case study, and total duration respectively. I_{jt} shows power plant cost of J type for t th period, M_{jt} refers to maintenance cost of power plant type j for t th period, F_{jt} is fuel cost for power plant type j for t th period, O_{jt} outage cost for power plant type j in t th period, and S_{jt} indicates remained capital cost for power plant type j in t th period. WASP program employs ongoing dynamic method to solve expansion problem. In this method the state of the problem in $k+1$ is determined based on its state in K th stage in such a manner that the resulting cost of transmission from K stage to $k+1$ stage and it's to be minimized.

B. Constraints

Several considerations such as hydro power plant effect, thermo-power plant maintenance planning, and constraints for fuel supply in different seasons have been taken in to account in WASP via dividing one year to several equal periods and studying each period individually. In each year (t th period), the critical period $k_{t,p}$ is the period in which the difference between available generating capacity with one load in a period is maximized. If the peak load in critical period is shown with $D_{t,p}$, the following formulation will be the first constraint considered in WASP as follow.

$$(1+a_t)D_{t,p} \leq P(k_{t,p}) \leq (1+b_t)D_{t,p} \quad (2)$$

In this equation $P(k_{t,p})$ represents generation ratio in critical period of t th, that shows the minimum storage, and b_t shows the maximum amount of system storage. In WASP, reliability is evaluated by LOLP index that leads to following formulation.

$$\text{LOLP}(k_{t,p}) \leq C_{t,p} \quad (3)$$

$$\text{LOLP}(k_{t,a}) \approx C_{t,a} \quad (4)$$

$C_{t,p}$ and $C_{t,a}$ are defined as standard amount or acceptable for this index in t th critical period. In each duration, all the components that may meet problem constraints are determined and then the optimal combination is selected based on minimum cost compared with previous period. The following formulation figures out other constraints in WASP.

$$U_t^0 \leq U_{jt} \leq U^0 + \Delta V_t \quad (5)$$

U_t^0 represents the minimum permitted amount of system arrangement in year the t th. ΔV_t is a constraint in this index for critical period of the t th. Suppose k_{jt} represents the number of different stages of generating units in implementation of J program in the t th year. So,

$$K_{jt} = k_{j,t-1} + A_{jt} - R_{jt} + U_{jt} \quad (6)$$

Where A_{jt} is vector of generated unit number j that has been developed in t year, R_{jt} is vector of generated unit number j that has been retired in t year, and U_{jt} is vector of generated unit number j that has been optimized in t year.

WASP program is characterized with having 12 choices of power plant types. These studies have usually done for duration of several years (up to 30 years). To see the effect of hydro-power plants without constant production that their production is changed seasonally, the studied period, must be less than one year. WASP enables you to divide one year to different unequally periods. In this case, the program attempts to balance load and generating within different periods of time. Considering the total consumption and the way of curve change (LDC curve) different features of power plants including maximum production, production cost, and a combination of new and old power plant are introduced in such a manner that provides not only the balance load and its generation but also the needed cost ratio for setting new power plants, power generation, and maintenance are minimized.

III. Proposed Algorithm for Generation Expansion Planning

In previous section generation expansion planning has been carried out by means of WASP-IV program. In this part this program utilizes MATLAB program, Fig. 1 shows it's correspond flowchart algorithm. In this flowchart you can firstly find input data consisting of load information, existent power plants, and candidate power plant in grid, and intended course duration, then generation and consumption has been compared within each period of time. If the generation rate exceeds consumption, no new power plant is needed; other wise additional power plants should be added. The objective function considered for this study is intended to minimize cost including, fuel maintenance, and operation. Moreover it must consider constraints. Among the most significant constraints that should be regarded in this algorithm can mention reliability (LOLP) and optimal combination of power plants. Finally, with considering objective function and constrains, type and capacity of power plant for supplying the load are determined.

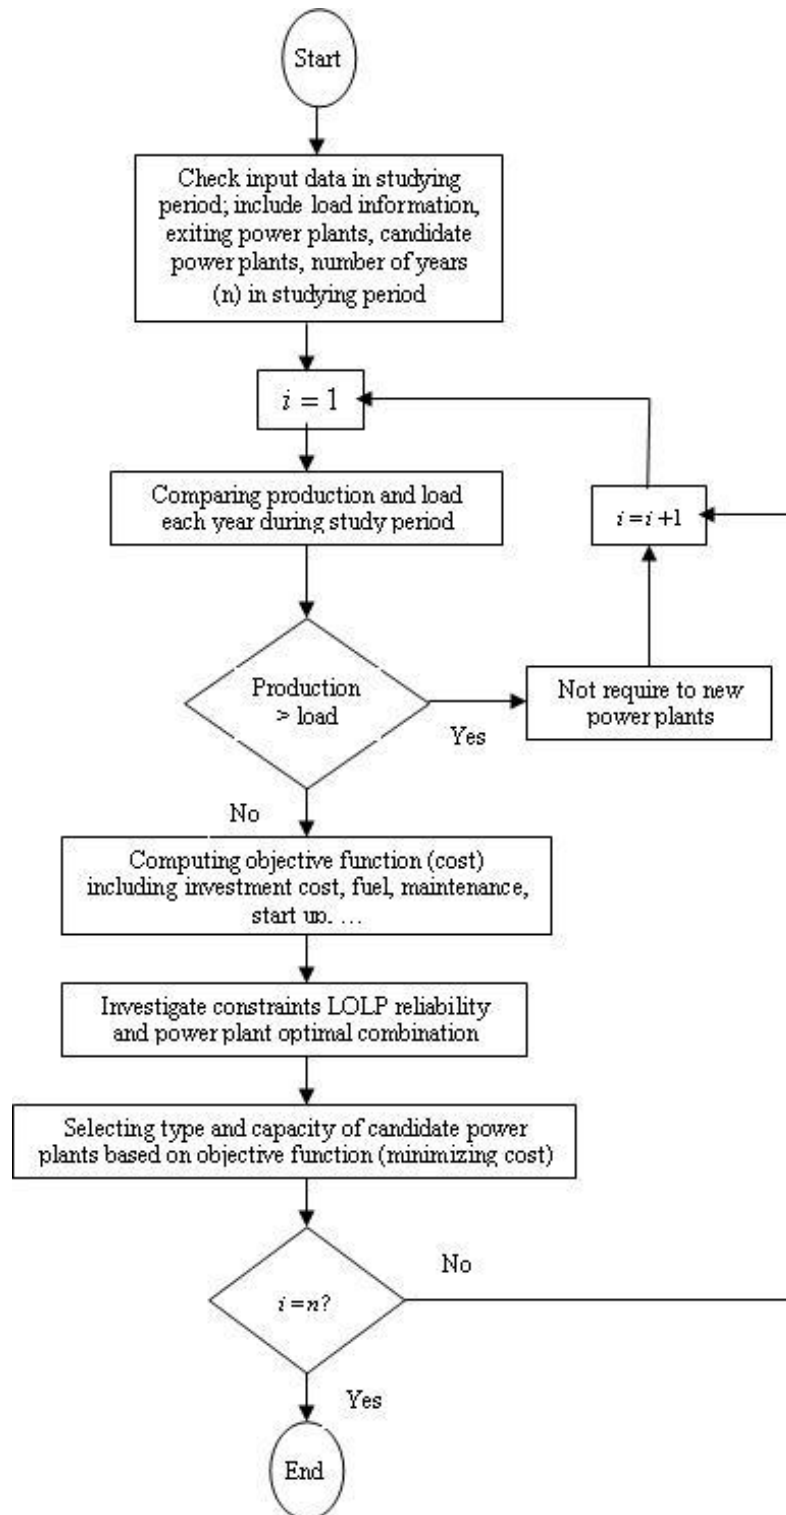


Fig. 1: the flowchart of proposed algorithm

IV. Implementation of the Proposed Algorithm for Khuzestan Power Grid in Iran

This program is coded by MATLAB program. After running the program, the results are showed in Table I.

Table I
Optimum solution of the proposed algorithm

OPTIMUM SOLUTION ANNUAL ADDITIONS: CAPACITY(MW) AND NUMBER OF UNITS OR PROJECTS FOR DETAILS OF INDIVIDUAL UNITS OR PROJECTS SEE VARIABLE SYSTEM REPORT SEE ALSO FIXED SYSTEM REPORT FOR OTHER ADDITIONS OR RETIREMENTS						
NAME			S325	G13S	CC40	G13B
Size(MW)			325	130	400	130
YEAR	LOLP	CAP				
2014	0.1273	0.				
2015	0.1212	325.	1			
2016	0.1135	130.		1		
2017	0.114	130.				1
2018	0.1110	0.				
2019	0.1038	800.			2	
2020	0.1012	0				
2021	0.0910	260.		2		
2022	0.0742	0				
2023	0.0101	650.	2			
2024	0.0027	0				
TOTALS			3	3	2	1

As indicated in Table 1, S325 (steam), G135 (small gas), CC40 (combined cycle), and G13b (big gas) are all candidate power plants. The justified number for power plants S32s, G13P, CC40, and G13B are 3, 3, 2, and 1, respectively.

V. Conclusion

Generation Expansion planning is a subdivision derived from general problem for power network expansion planning. In this planning, the efficiency or qualification of power plant for Khuzestan power grid in Iran in order to supply consumers load has been studied according to reliability constraint. In the case of power plant being in efficient, the generation expansion planning identifies the appropriate types of power plants, their capacity, and time duration to meet designed Efficiency, along with, the minimum cost for operating new power plants .This study primarily represents an evaluation for generation expansion by using dynamic programming in Khuzestan power grid in Iran within a time period of 10 years.

References

- [1] X. Wang, J. R. McDonald, "Modern Power System Planning", McGraw-Hill Publication, 1994.
- [2] Y.C. Kim, "Multicriteria Generation Expansion Planning with Global Environmental Considerations", IEEE Transactions on Engineering Management, Vol. 40, No. 2, May 1993, pp. 154-161.
- [3] Y.Fukuyama, H. D. Ching, "A Parallel Genetic Algorithm for Generation Expansion Planning", IEEE Transaction on Power System, Vol. 11, No.2, May 1996, pp. 955- 961.

[4] D. Shively, et al , "Energy Storage Methods for Renewable Energy Integration and Grid Support", IEEE Energy 2030, Atlanta, Georgia, USA, 17-18 November 2008.

[5] P. D.Brown, J.A. Pecos Lopes, Manuel A.Matos, *Optimization of Pumped Storage Capacity in an Isolated Power System With Large Renewable Penetration*. IEEE Transaction On Power System, Vol.23, No.2, May 2008.

[6] S. M. Schoenung, C. Burns; "Utility Energy Storage Applications Studies"; IEEE Transaction on Energy Conversion; Vol.11, No.3, September 1996.

[7] A. S.malik, B. J.Cory; "Assessment of Pumped Storage Plant Benefits in Fuel Budgeting and Operational Planning"; IEE International Conference Management, November 1991, Hong Kong.

[8] P. Hungchen, "Pumped-Storage Scheduling Using Evolutionary Particle Swarm Optimization". IEEE Transaction on Energy Conversion, VOL. 23, No.1, March 2008.